


**SIZING**

\*750 GALLON MINIMUM LIQUID CAPACITY (42" LIQUID DEPTH)  
 SIZING SHALL BE PER SECTION 20.6 OF TOHO WATER AUTHORITY  
 SPECIFICATIONS AND PER THE LATEST FLORIDA BUILDING CODE.

**NOTES:**

1. STRUCTURE SHALL CONFORM WITH FLA. BUILDINGS CODE AND F.D.O.T. DESIGN STANDARDS. PROVIDE FOR A MINIMUM H-20 LOADING.
2. CAST-IN-PLACE STRUCTURES SHALL BE DESIGNED BY FLORIDA LICENSED ENGINEER.
3. PRECAST STRUCTURES SHALL CONFORM TO ASTM C478
4. GREASE TRAP SHALL BE 2 COMPARTMENT TYPE.
5. LIDS SHALL BE LABELED "GREASE".
6. INSTALLATION SHALL BE IN ACCORDANCE WITH STANDARD PLUMBING CODES.
7. INLET AND OUTLET PIPING REQUIRE A TWO-WAY CLEANOUT TEE.

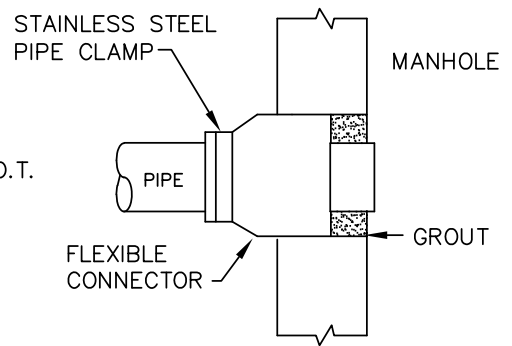

**FLEXIBLE CONN. DETAIL**

**GREASE INTERCEPTOR**