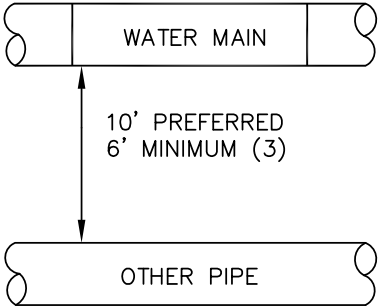
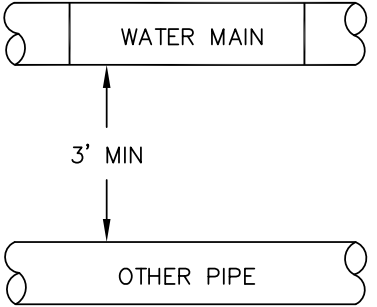
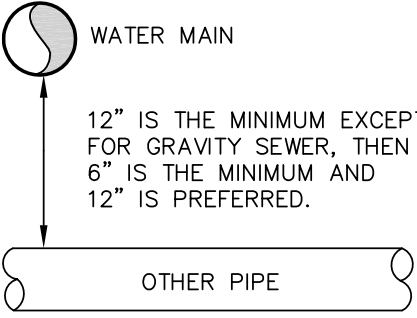
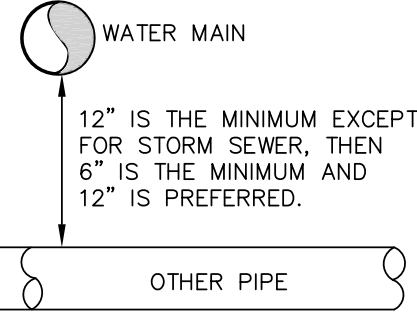
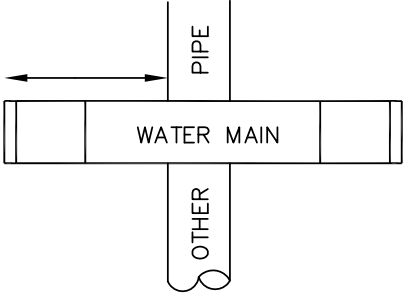
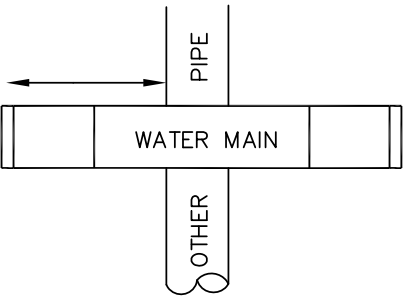


## HORIZONTAL & VERTICAL SEPARATION FROM OTHER UTILITIES

OTHER PIPE	(a) GRAVITY OR PRESSURE SANITARY SEWER (b) SANITARY SEWER FORCE MAIN (c) RECLAIMED WATER (4)	(a) STORM SEWER, (b) STORMWATER FORCE MAIN, (c) RECLAIMED WATER (2)	ON-SITE SEWAGE TREATMENT & DISPOSAL SYSTEM
HORIZONTAL SEPARATION	 <p style="text-align: center;">10' PREFERRED 6' MINIMUM (3)</p>	 <p style="text-align: center;">3' MIN</p>	10' MIN.
CROSSINGS (1)	 <p style="text-align: center;">12" IS THE MINIMUM EXCEPT FOR GRAVITY SEWER, THEN 6" IS THE MINIMUM AND 12" IS PREFERRED.</p>	 <p style="text-align: center;">12" IS THE MINIMUM EXCEPT FOR STORM SEWER, THEN 6" IS THE MINIMUM AND 12" IS PREFERRED.</p>	—
JOINT SPACING AT CROSSINGS (FULL JOINT CENTERED)	<p style="text-align: center;">ALTERNATE 6 FT MINIMUM</p> 	<p style="text-align: center;">ALTERNATE 3 FT MINIMUM</p> 	—

- (1) WATER MAIN SHOULD CROSS ABOVE OTHER PIPE. WHEN WATER MAIN MUST BE BELOW OTHER PIPE, THE MINIMUM SEPARATION IS 12 INCHES.
- (2) RECLAIMED WATER REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.
- (3) 3 FT FOR GRAVITY SANITARY SEWER WHERE THE BOTTOM OF THE WATER MAIN IS LAID AT LEAST 6 INCHES ABOVE THE TOP OF THE GRAVITY SANITARY SEWER.
- (4) RECLAIMED WATER NOT REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.