


LIMITED RIGHT-OF-WAY CONDITION

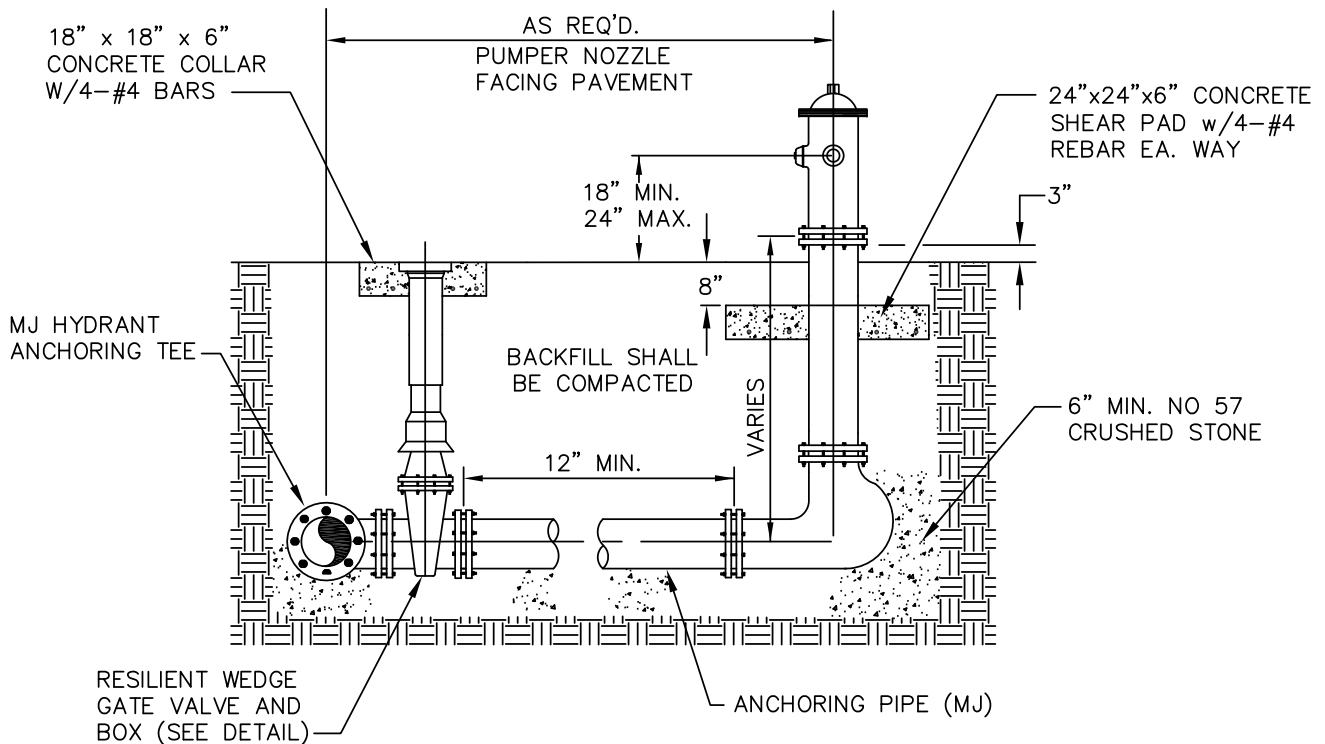

TYPICAL CONDITION

NOTES:

1. FIRE HYDRANT SHALL BE SUPPLIED WITHOUT A WEEP HOLE OR WITH A PERMANENTLY PLUGGED WEEP HOLE.
2. CLEARANCE BETWEEN BOTTOM OF BOLTS AND TOP OF SHEAR PAD SHALL BE 3" MINIMUM.
3. VALVE SHALL BE INSTALLED PER THE VALVE AND BOX DETAIL.
4. MAINTAIN A PLANTING CLEARANCE AROUND HYDRANT OF 7'-6" FROM THE FRONT AND BOTH SIDES AND 4'-0" ON THE REAR. PLANTINGS IN CLEAR AREA TO BE A MAXIMUM OF 12" HIGH.

FIRE HYDRANT DETAILS