



Nonintrinsically safe wiring terminals

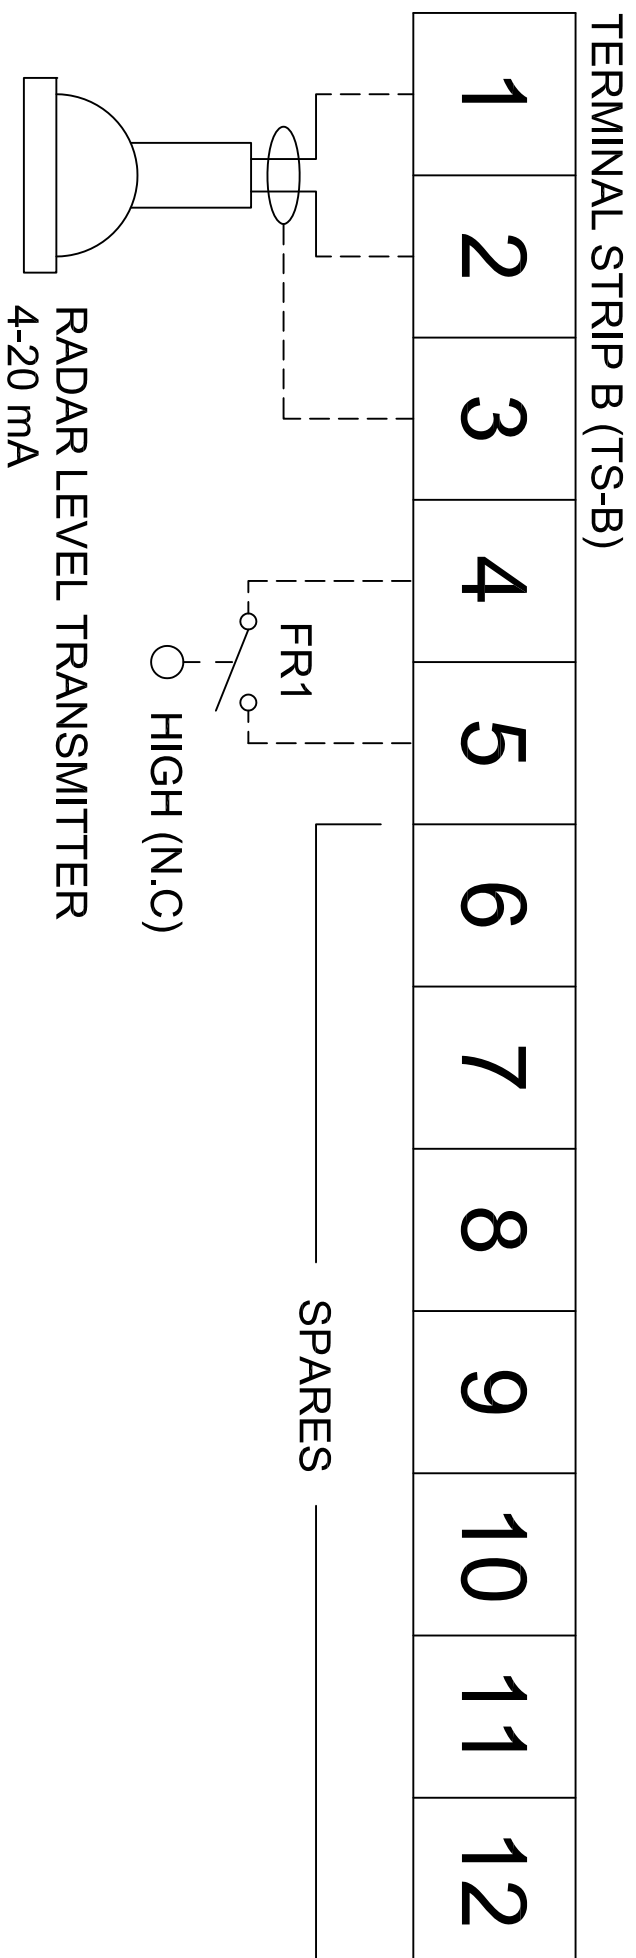


CONTROL JUNCTION BOX

Nonintrinsically safe wiring terminals

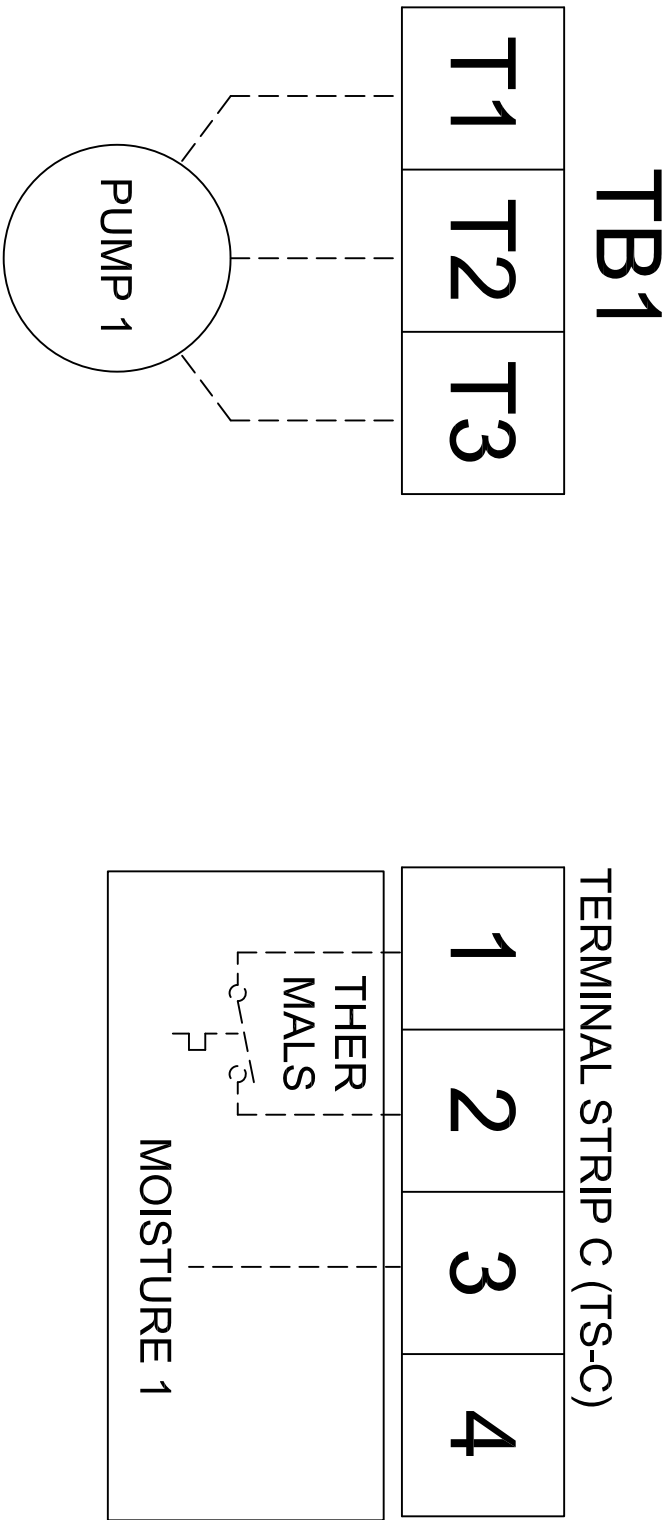


PUMP 1 JUNCTION BOX

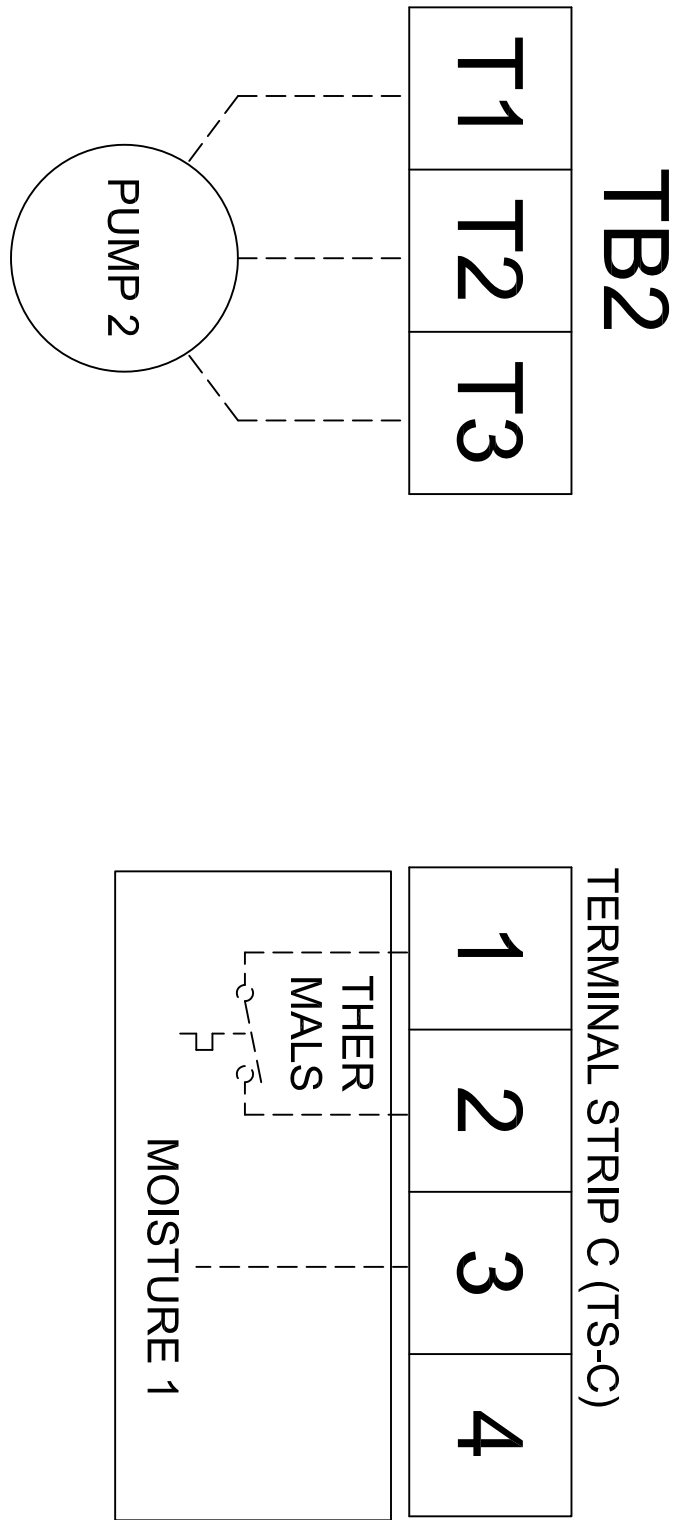


PUMP 2 JUNCTION BOX


CONTROL JUNCTION BOX

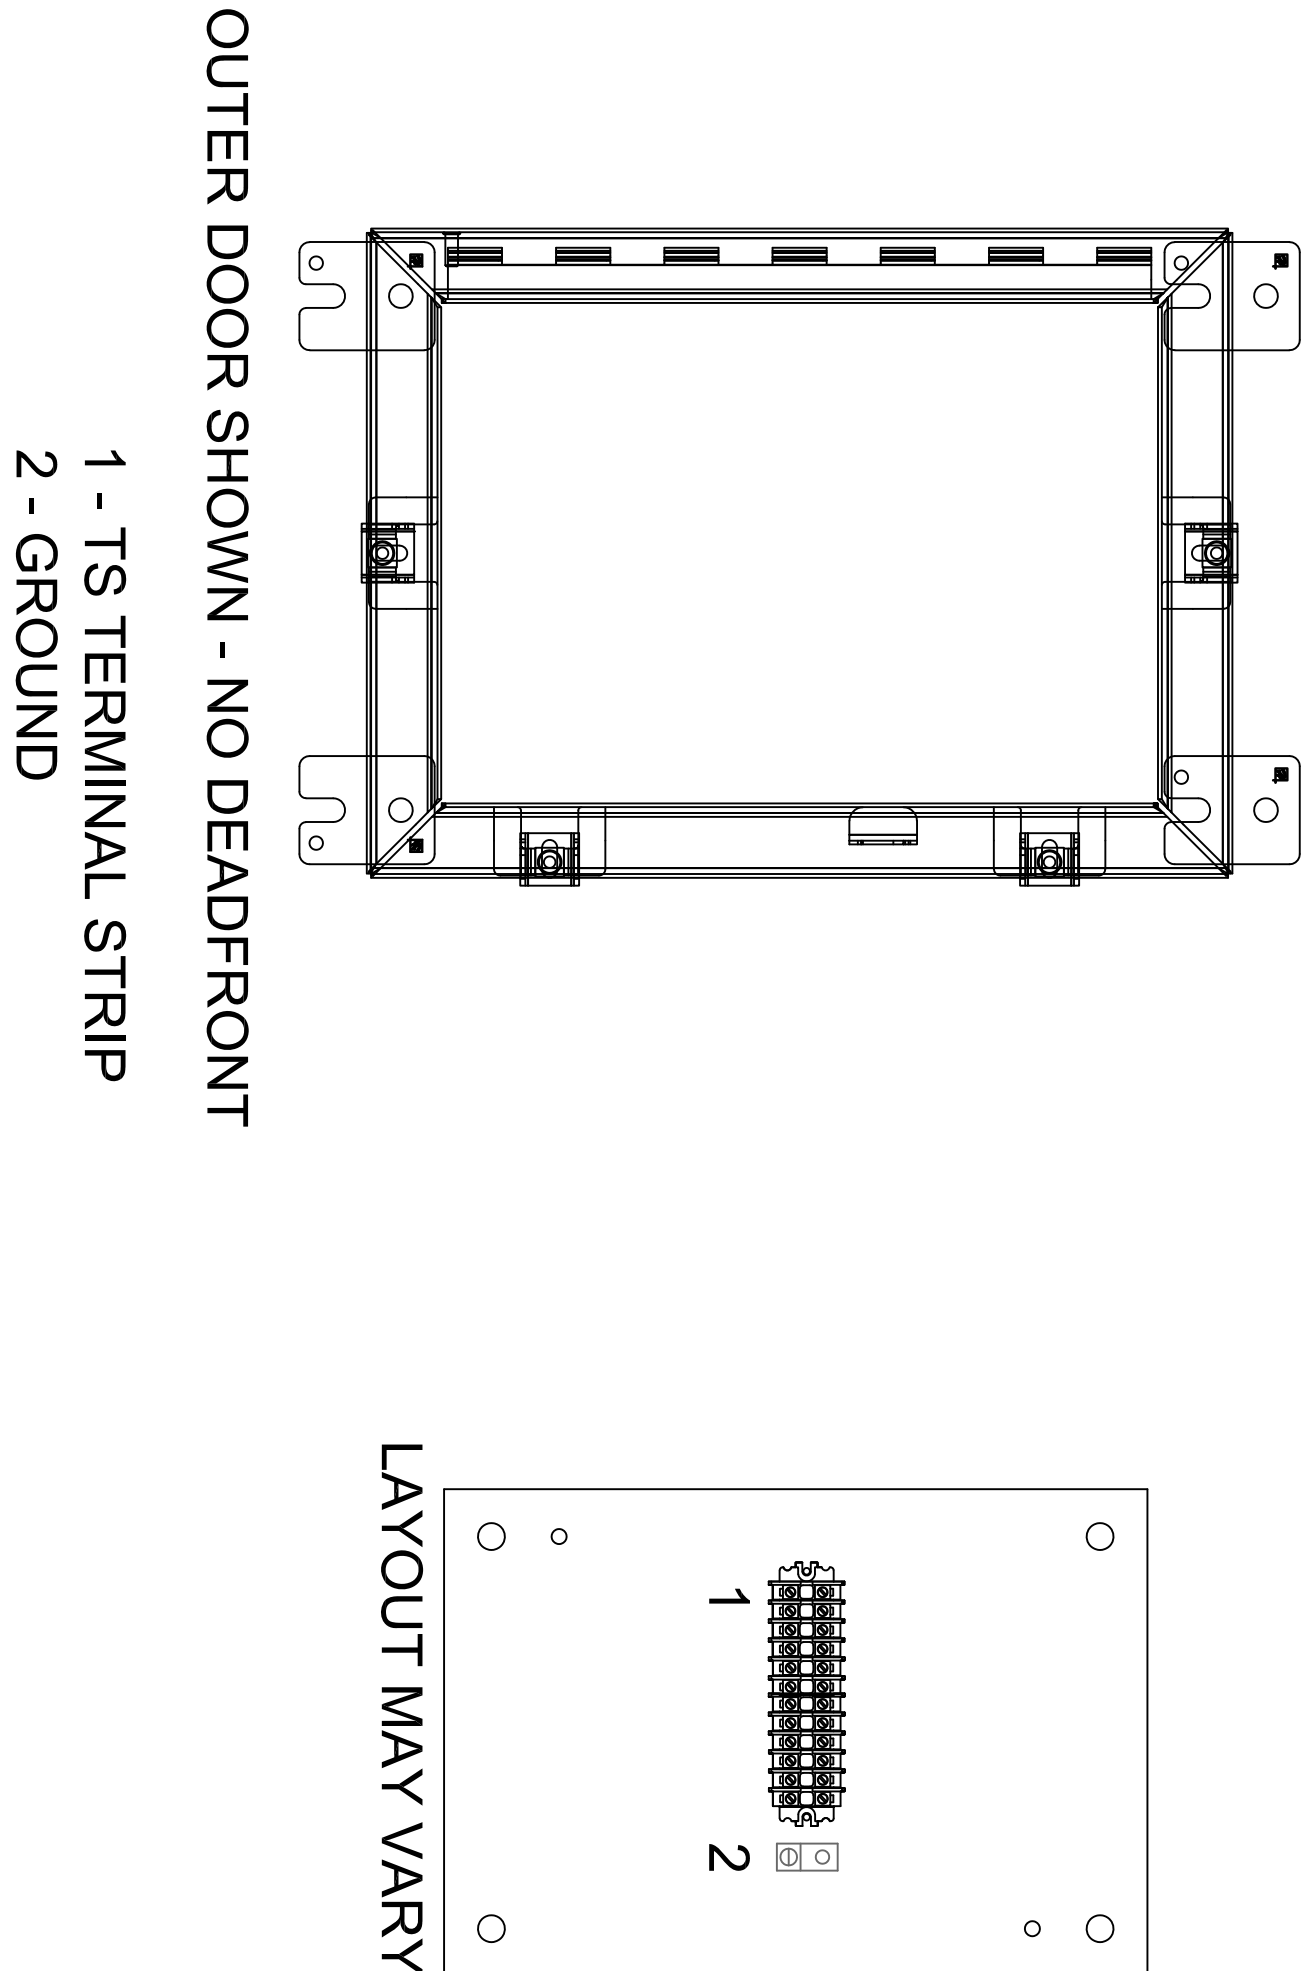

PUMP 1 & 2 JUNCTION BOXES
(TYPICAL OF 2)

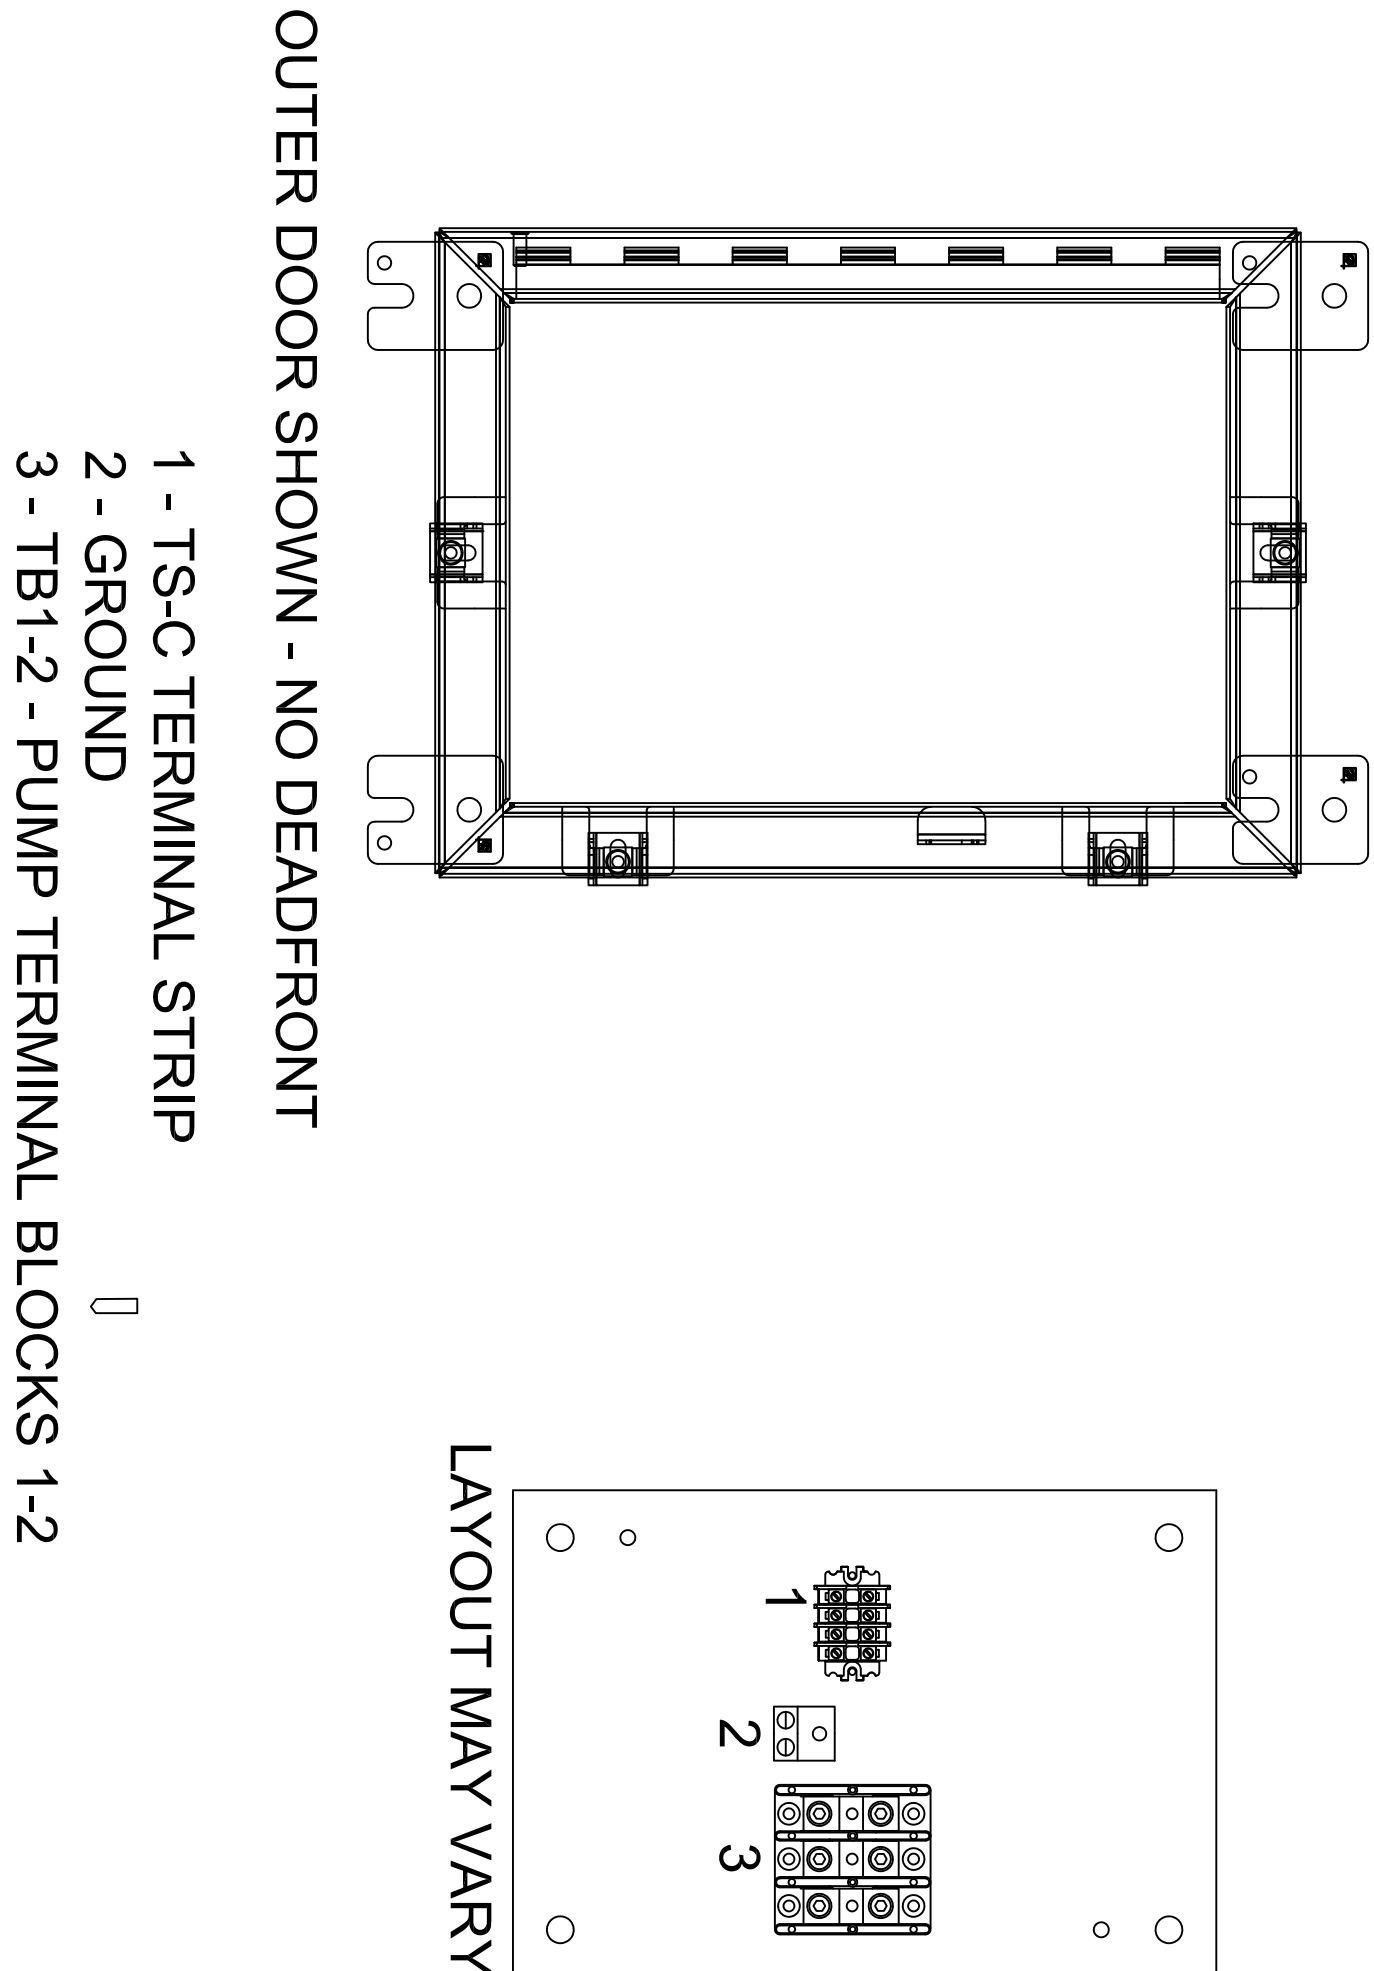

LIFT STATION JUNCTION BOXES

	EFFECTIVE DATE:	04/01/2025
	BOARD APPROVED DATE:	01/22/2025
	PREVIOUS VERSION:	NA
	DRAWN BY:	STA-CON
	REVISED BY:	DT