


MINIMUM DEPTH
TO TOP OF
PIPE – 6' (72")



MAXIMUM DEPTH
OF SEALED
VALVE BOX –
20' (240")

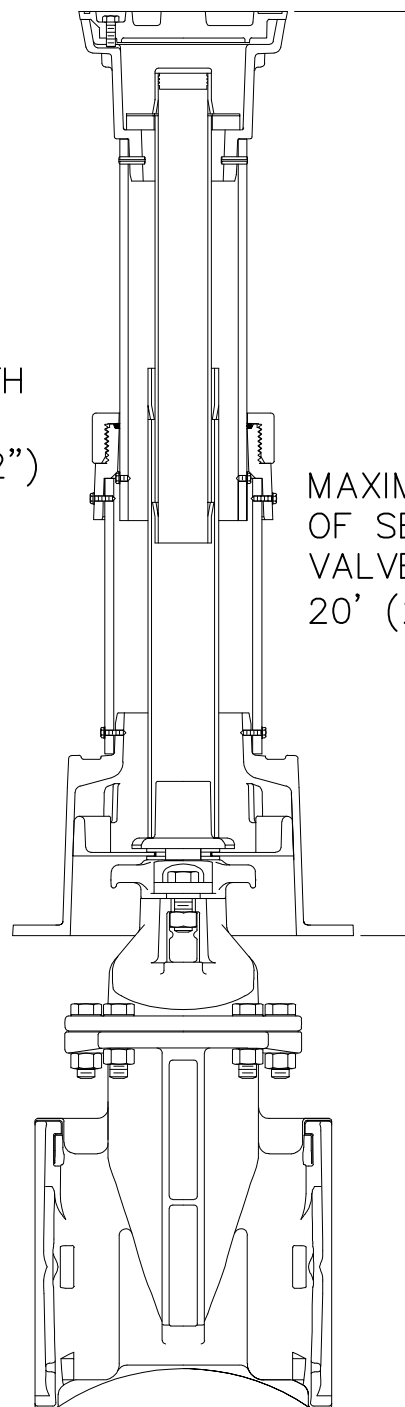

EFFECTIVE DATE:	04/01/2025
BOARD APPROVED DATE:	01/22/2025
PREVIOUS VERSION:	NA
DRAWN BY:	AFC
REVISED BY:	DT

ADJUSTABLE SEALED VALVE BOX

DRAWING NUMBER

17.1